

---

**From:** [REDACTED]  
**To:** [REDACTED]  
**CC:** [REDACTED]  
**Sent:** 2/24/2021 7:57:22 AM  
**Subject:** RE: O8W-PM [REDACTED] - Bucks Creek 1101 Phase 1,2&3 - Pre-Engineering Meeting

Good Morning [REDACTED]

I would be happy to reach out to Caltrans and UPRR reps in order to try and arrange a meeting to discuss the proposed plans on-site. I have the following contacts that I would be reaching out to for said meeting, see below. Before I contact them, does anyone have any other contacts that should be invited to said meeting?

UPRR MTM: [REDACTED]  
Caltrans Local Inspector: [REDACTED]

Thank you,  
[REDACTED]

---

**From:** [REDACTED]  
**Sent:** Wednesday, February 24, 2021 7:42 AM  
**To:** [REDACTED]  
**Cc:** [REDACTED] >  
**Subject:** RE: O8W-PM [REDACTED] Bucks Creek 1101 Phase 1,2&3 - Pre-Engineering Meeting

Thanks [REDACTED]  
[REDACTED] and [REDACTED]

Would it be possible to hold a meeting as early as next Monday, with two Caltrans and at least one RR representative? I would like to meet at the North end of the Cresta Bridge (nice large area to park) and would need folks with the following skill-set from each entity:

1. Caltrans Rep-Needs to be familiar with the design of the Cresta Bridge, and the electrical systems that feed the 'tunnel lights' out of the pedestal near the Cresta Dam.
2. Caltrans Rep-Possibly another person that is familiar with DSDD and Caltrans standards so we can know upfront if boxes will be acceptable in the travel-lane. We also would like to know if we can use 'Caltrans specified guard-rail' to protect the 'traveling-public' where we can't place our new infrastructure 52' from ETW....there are only a few areas like this in the entire ~4-mile project.
3. RR Rep-Needs to be familiar with the RR electrical system between the Cresta Dam and Bucks Creek Sub-station.

[REDACTED] mention in another email that he may have contacts at Caltrans and the RR...please work together to hopefully gain the correct audience for this future meeting.

Please advise,

**Pacific Gas and  
Electric Company**

---

**From:** [REDACTED]  
**Sent:** Tuesday, February 23, 2021 6:40 PM  
**To:** [REDACTED]  
**Cc:** [REDACTED]

**Subject:** RE: O8W-[REDACTED] Phase 1,2&3 - Pre-Engineering Meeting

Hi [REDACTED]

Yes, [REDACTED] (cc'd), with the support of [REDACTED] behind-the-scenes, can support our Land Permitting needs for Bucks Creek.

Thank you, [REDACTED]



---

**From:** [REDACTED]  
**Sent:** Tuesday, February 23, 2021 3:01 PM  
**To:** [REDACTED]  
**Cc:** [REDACTED]

**Subject:** RE: [REDACTED] Phase 1,2&3 - Pre-Engineering Meeting

Hi [REDACTED]

This project is unique in that I will need to work with the RR and Caltrans upfront to be able to correctly scope the project.

1. Cresta Bridge Crossing-Per the scoping documents we are to first determine if we can attach our conduits to Caltrans Bridge before spanning the river OH...so the preferred option is to attach to the bridge which will require for my team to meet with Caltrans team.
2. RR has a transformer that we need to determine if it is still needed, and if so we will need to span the river to feed, and that will require upfront coordination.
3. DSDD will be needed since we will have facilities sticking up in Caltrans R/W within 52' of ETW.....what I need to know is if Caltrans will allow us to install 7-boxes within the lane since there is very limited room outside of ETW? There is another project just south of this one that is under-construction where they are trenching ~2' inside of ETW, but placing their boxes outside of ETW.
4. We serve our power to a Caltrans pedestal that feeds the lights in the three consecutive tunnels, we need to feed that pedestal from a different source that will require upfront coordination with Caltrans.

Is there someone on your team that could be my liaison between our project-team and [REDACTED] and the [REDACTED]

Please advise,

[REDACTED]

Pacific Gas and  
Electric Company

---

**From:** [REDACTED]  
**Sent:** Tuesday, February 23, 2021 2:35 PM  
**To:** [REDACTED]  
**Cc:** [REDACTED]  
**Subject:** RE: O8W-PM [REDACTED] Phase 1,2&3 - Pre-Engineering Meeting  
**Importance:** High

Hi [REDACTED]

Can you please work with [REDACTED] & [REDACTED] to ensure that you have what you need in order to determine if any portion of [REDACTED] will trigger a DSDD? If there are areas that will trigger the DSDD, can you delineate them on the KMZ for all of us? Thank you!

Hi [REDACTED]

Can you please provide us with the ETA for the preliminary Basemapping? Thx! [REDACTED]




---

**From:** [REDACTED]  
**Sent:** Tuesday, February 23, 2021 2:14 PM  
**To:** [REDACTED]  
**Cc:** [REDACTED]  
**Subject:** RE: O8W-PM [REDACTED] Phase 1,2&3 - Pre-Engineering Meeting

Hi [REDACTED]

Attached are the 'base-map' limits in a kmz. file. As you will see, we need our base-map to go about ~100' into the tunnel at the south end (see pedestal in picture below....please begin about ~50 beyond this point which is about ~100' beyond the Cresta Dam).

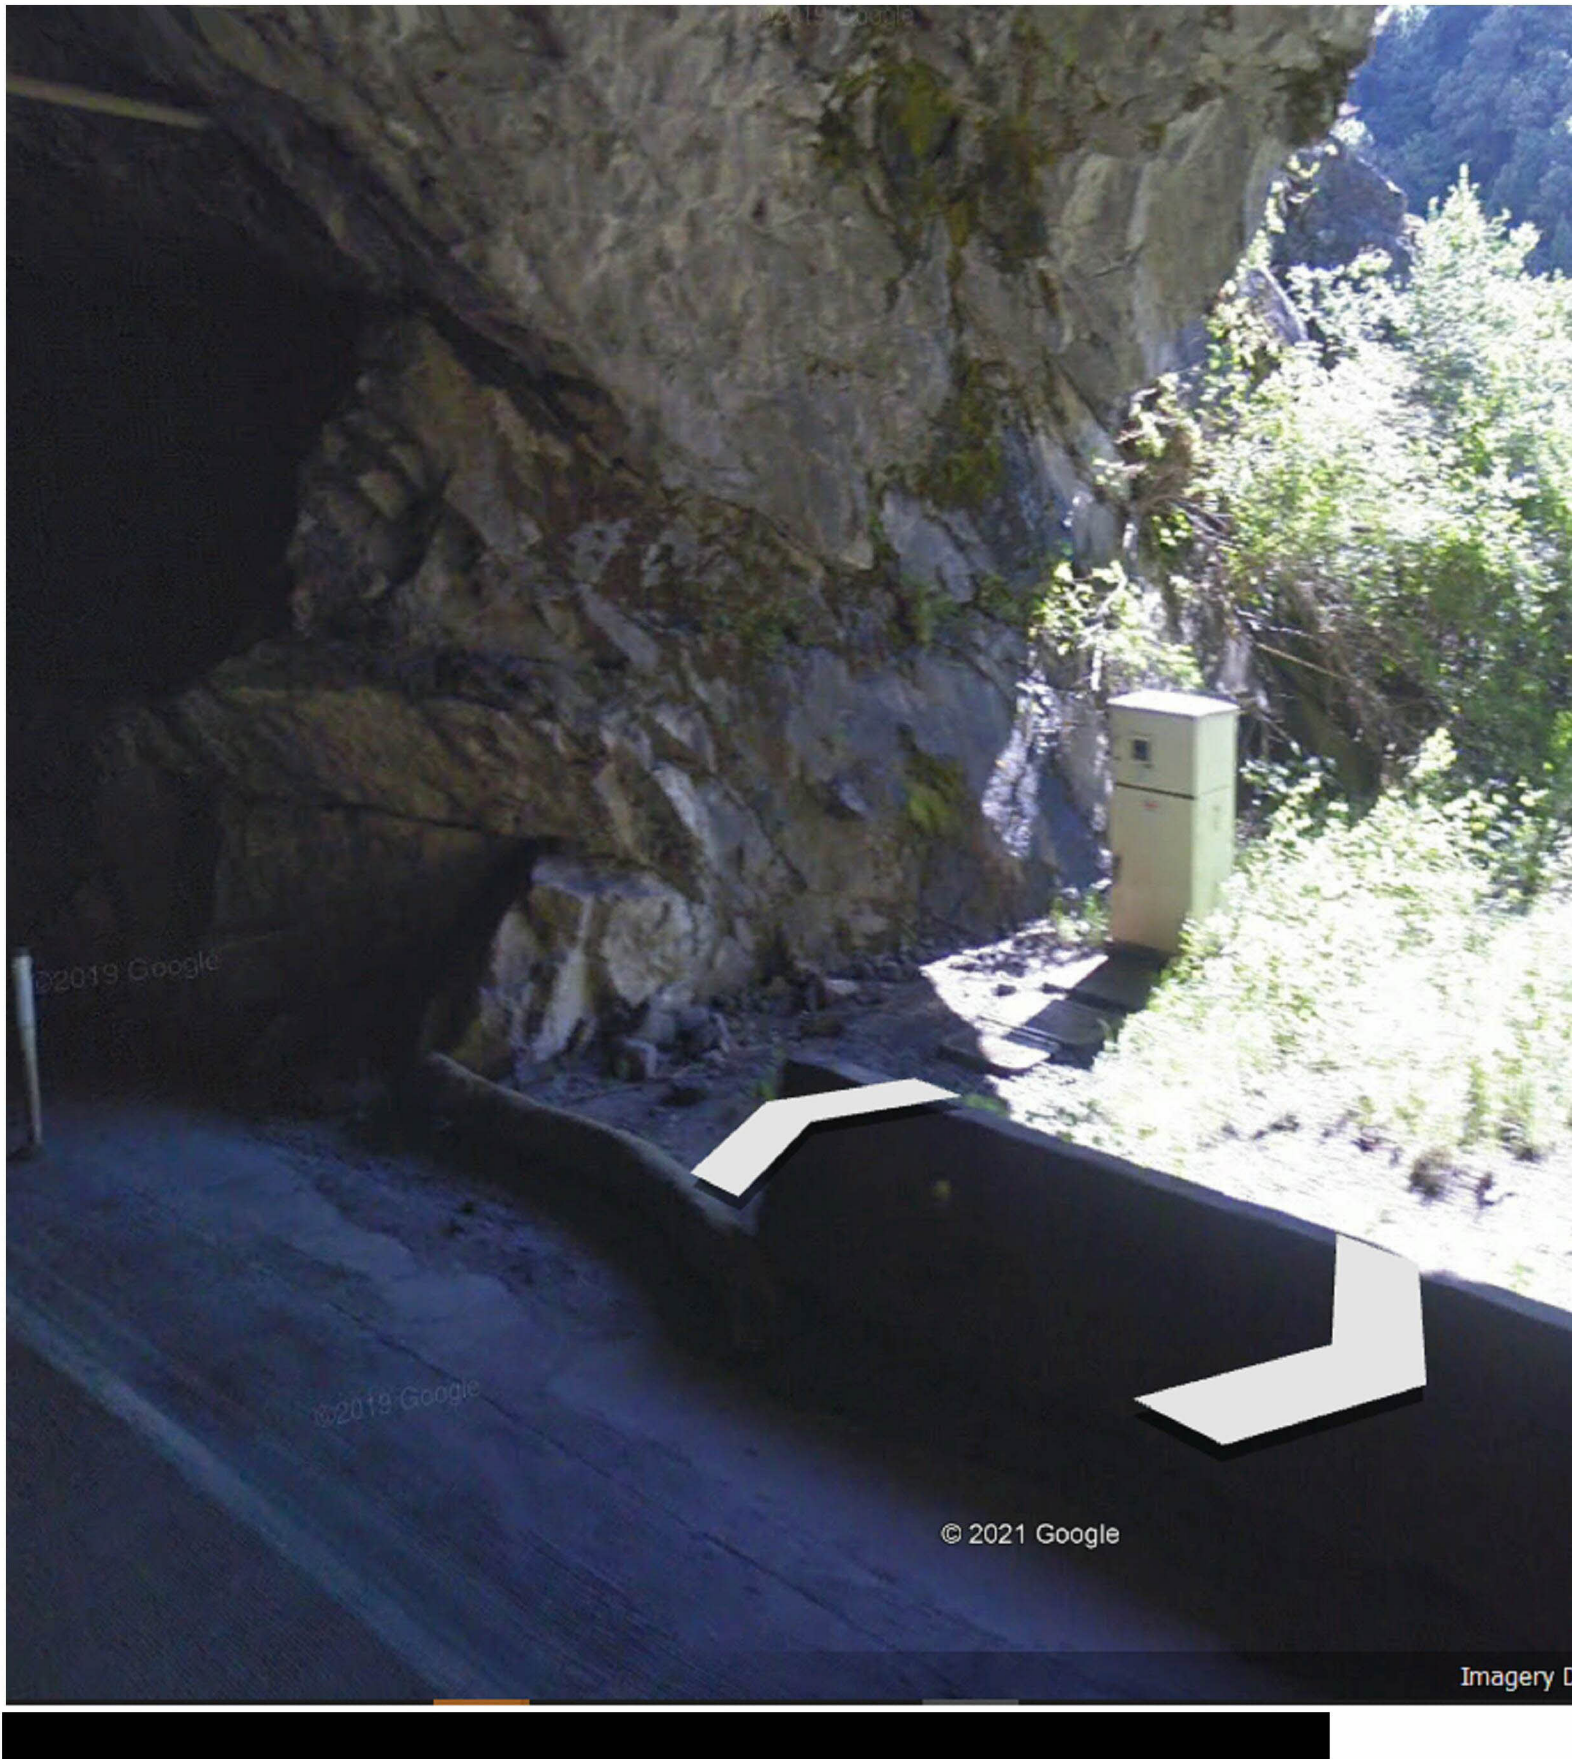





Please advise to all on this email when you have an expected completion date for this base map?

Thanks in advance,



Pacific Gas and  
Electric Company

---

**From:** [REDACTED]

**Sent:** Tuesday, February 23, 2021 1:34 PM

**To:** [REDACTED]

**Cc:** [REDACTED]


**Subject:** FW: O8W-PM [REDACTED] - Bucks Creek 1101 Phase 1,2&3 - Pre-Engineering Meeting

**Importance:** High


[REDACTED] and [REDACTED]

For Bucks Creek there is quite a bit of work surrounding Hwy 70 and we will need a Land Department Base Maps prepared for all 3 Orders. This will delay the EOD dates until these can be developed and provided to the Vendor... We will also need answers to the questions outlined by [REDACTED] below...

# Bucks Creek 1101- PM# [REDACTED] Overview Map

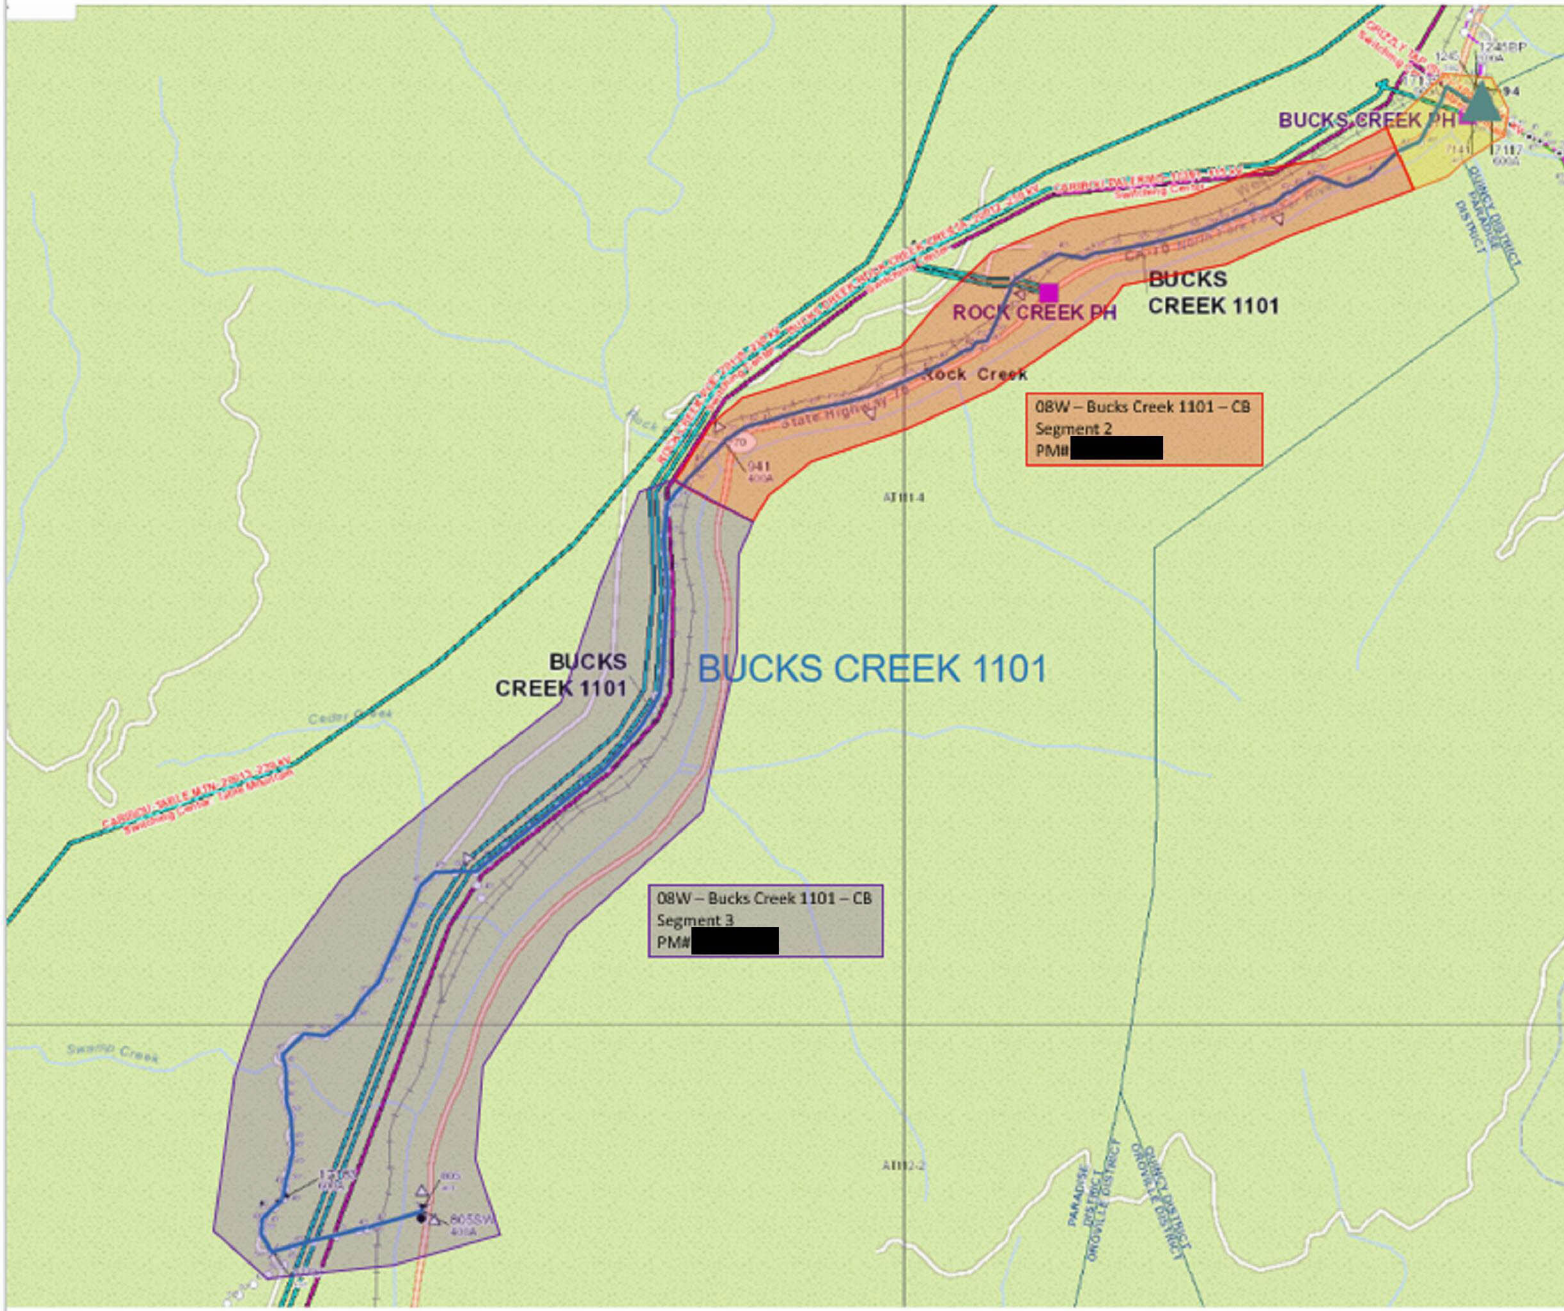


Thxs,



*Some of the measures included in this email are contemplated as additional precautionary measures intended to further reduce the risk of wildfires.*



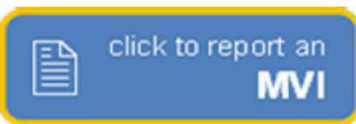

**From:** [REDACTED]  
**Sent:** Tuesday, February 23, 2021 11:29 AM  
**To:** [REDACTED]  
**Cc:** [REDACTED]

**Subject:** O8W-PM [REDACTED] Phase 1,2&3 - Pre-Engineering Meeting

All,  
 Good meeting yesterday...I feel its best to get everything 'on the table' as soon as possible in the 'life cycle' of any project, here is that attempt.

I will set up a virtual 'follow up' meeting next week to discuss who is taking what action items below.....first I need confirmation that we can even change scope, and what the process looks like.


Here are my notes/action items:

PM [REDACTED] (Phase 1)

1. We learned the following:
  - a. Sub-Station (per Foreman [REDACTED]) is undergoing its own project under PM [REDACTED], of which is in UNSC status, and the following locations have 'overlap' scope:
    - i. Location 1, pole is being replaced under Sub PM
    - ii. Location3, pole is being replaced under Sub PM
    - iii. It appears that PM [REDACTED] will be completed before our O8W project begins, so it is imperative that we work to have their scope match our needs...ASAP. I will take this action with the help of [REDACTED] and [REDACTED] to supply the details.
2. Location 2 has a bank of three transformers not indicated in any of our scoping documents...do we really need to replace this steel pole?



3. 'Underground' scope between locations 102 and 101 doesn't make sense when the following are considered:
  - a. How does this scope reduce risk?
  - b. Is 'undergrounding this small section 'constructible' when you consider the following:
    - i. Stairway, creek crossing, and proximity to sub-station
  - c. See picture



3. All parties had the same burning question regarding the 'river crossing';
  - a. Why couldn't we move Location 4 to the east side of CA-70 and remove Locations 5, 6, 7, and 8 of the OH-Hardening scope? This would require an increase in OH-UG scope on PM [REDACTED] of about the same distance of OH-Hardening scope begin removed from PM [REDACTED]
  - b. Here is the basic idea in RED.....the dashed line is proposing UG:

PM [REDACTED] (Phase 2)

1. Preliminary Drawing was not provided

2. Trench Location:

- a. We determined that landing the trench ~2' into the lane from the ETW (fog-line) was probably the best consistent location of which it would be ideal if the 7-boxes could be landed in the 'travel lane'. This will need to be discussed with Caltrans before moving forward with the design.
- b. Any proposed poles to be placed within 52' from ETW if absolutely needed will need 'gaurdrail' protection to assist with DSDD exception requests.

3. Rock Creek Bridge Crossing

- a. Scope is not clear for this crossing since it leads us to a 'what-if' scenario of, if Caltrans doesn't allow the conduits to be attached to the existing bridge we should span the river OH. This will need to be discussed with Caltrans to first determine 'if' we can attach to their bridge before scope is locked.

PM [REDACTED] (Phase 3)

1. RR Siding Service/Tx located in picture below also has a weather station on pole and scope for

replacing this Tx is another 'what if' scenario of:

- a. Does the RR need the service?
- b. If they do can we serve via a crossing at the Cresta Dam.
- c. If Cresta Dam doesn't work should we cross the river a different location?
- d. What do we do about the weather station?



e. Here is pic:


2. Termination of UG scope at Cresta Dam is not clear for the following reasons:

- a. Not constructible to 'trench' to....see pic:



- i. We were not able to see the panel at the Cresta Dam to determine loading needs.
  - ii. It also appears that this transformer feeds a Caltrans Pedestal for lights in the tunnels.
- b. The question is:
  - i. First, do we need the river crossing at the outflow of the dam if we are going to cross the river at a different location to feed the RR Tx?
    1. If we don't need the river crossing could we install a pad-mount Tx and trench in a service through the tunnel ~100LF to the Caltrans pedestal and then feed the

Cresta Dam panel?

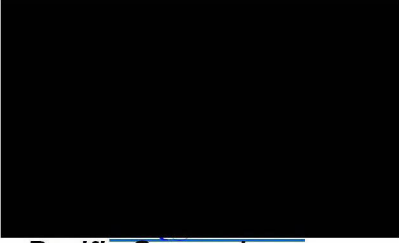

Pacific Gas and  
Electric Company