

PG&E WILDFIRE RISK MODELING

FEBRUARY 24, 2021

CONFIDENTIAL -- FOR INTERNAL DISCUSSION

Safety



Earthquake

Duck, Cover, & Hold



Emergency Plan & Exit Strategy

Have a plan for yourself and your household



24/7 Nurse Care Line

If you experience a work-related discomfort or injury, call 1-888-449-7787 and notify your supervisor.



Wash your hands!



Wear a Mask



Practice social Distancing

California can stop the spread

Add your phone today to California's exposure notification system



<https://canotify.ca.gov/>

Meeting Agenda

Date:	February 24, 2021
Desired Outcomes:	<ul style="list-style-type: none">Operational Observer gains an in depth understanding of the 2021 Wildfire Distribution Risk model.Specifically, the MaxEnt algorithm and application of the Technosylva wildfire simulation, the predictive power of the models and how model views can be used to provide insights for the development of wildfire mitigation workplans.

Meeting Agenda

	What - Content	Who - Facilitator(s)	Slide(s)	Duration
1	Review Safety and meeting objectives			
2	Modeling objectives and methodology			
4	Ignition Probability Deep Dive			
5	Wildfire Consequence – Application of Technosylva			
6	Model Views			

CONFIDENTIAL – FOR INTERNAL DISCUSSION


2

Modeling Objectives and Methodology

Risk Data and Analytics Team Objectives

- (1) Provide situational awareness of risk,
- (2) Enable risk-informed decisions making, and
- (3) Enable PG&E to develop line-of-sight on risk reductions from wildfire risk mitigation initiatives


As outlined in the model documentation, approach these objectives through a systematic methodology

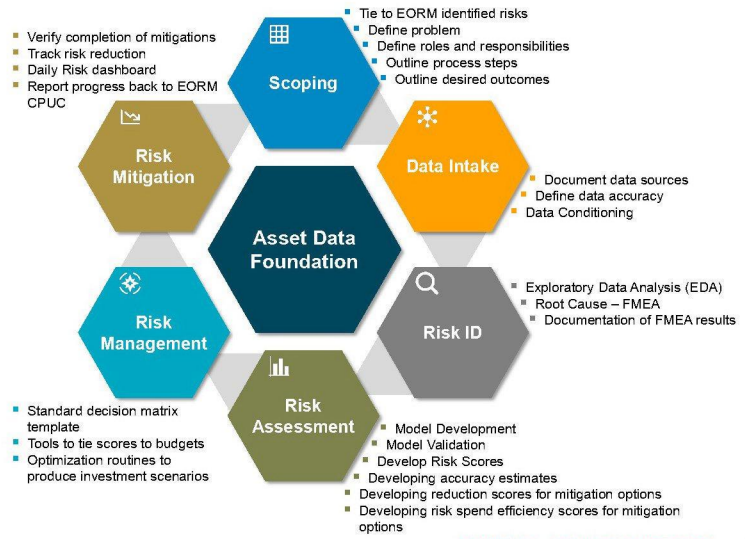

CONFIDENTIAL – FOR INTERNAL DISCUSSION

Evaluating Wildfire Risk utilizes the risk assessment concepts from RAMP, defining risk as the product of likelihood and consequence

PG&E's wildfire risk modeling framework is aligned with our wildfire risk bowtie defined in the 2020 RAMP, and is used to assess Probability of Ignition or Likelihood of Risk Event (LoRE) and the Consequence of Risk Event (CoRE)

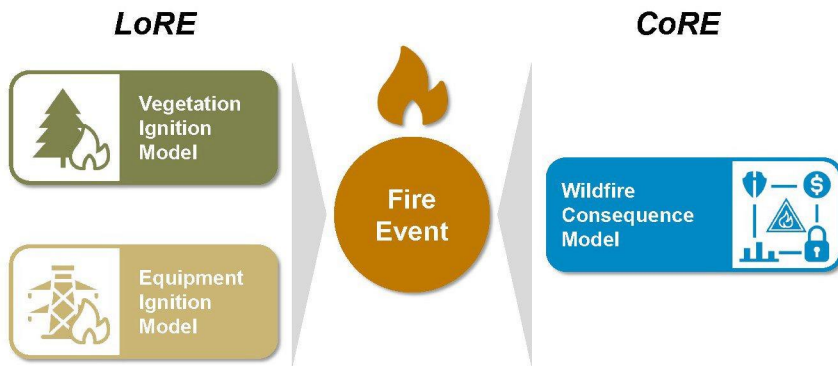

Risk = Ignition Probability x Wildfire Consequence

Mitigations

 System Hardening Prioritization

 Enhanced Vegetation Management Prioritization

 Inspection Ordering & Cadence

 Repair Prioritization

CONFIDENTIAL - FOR INTERNAL DISCUSSION

4

Ignition Modeling Approach using MaxEnt

MODEL DETAIL

Methodology



- Divide Ignition Events into distinct categories of Vegetative or Conductor Caused
- Make vegetative or conductor ignition predictions with MaxEnt model at a scale of 100m x 100m "pixels" along the Dx grid
- Rolls-up pixels to Circuit Protection Zones
- For each pixel, assign risk score based upon the product of: LoRE X CoRE

Approach



- Use MaxEnt model technique due to its ability to predict rare and unique events in a given region and their probability of occurring both geospatially and under aggregated weather conditions
- Ignition probabilities calculated every 100m along conductor lines and then assigned to a pixel along Dx grid
- Ignition probabilities are combined with consequence (CORE) to determine overall risk

Ignition Probability



Likelihood:
via ignition prediction (Max Entropy)

- Effect:** via :
- (1) Ignition spread (Technolyva)
 - (2) Ignition consequence (Technolyva)

MAX ENT MODEL

Training:


On reportable California Public Utilities Commission (CPUC) Ignition Events and related geospatial and temporal weather data

Vegetative/Conductor Ignition Model:

Two models were developed based on two specific risk mitigation priorities and their associated, relevant risk drivers – EVM and SH


Ignition likelihood:

The likelihood of ignition in 100m x 100m pixels determined by either Vegetative or Conductor

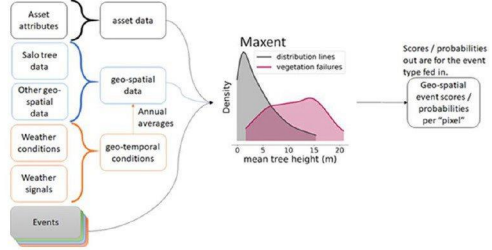


CONFIDENTIAL – FOR INTERNAL DISCUSSION

Maximum Entropy (MaxEnt) Approach

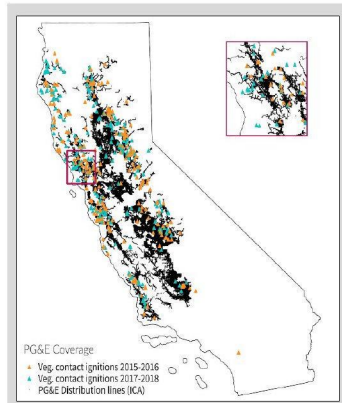


Locations and characteristics of areas where ignitions occur are collected and compiled

+

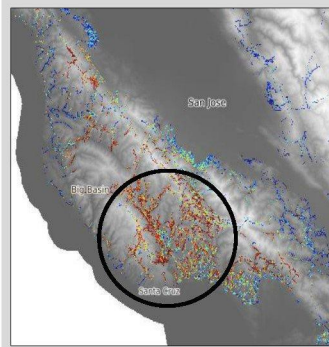

Similarities between the conditions at ignition points are identified, and evaluated for commonality

=

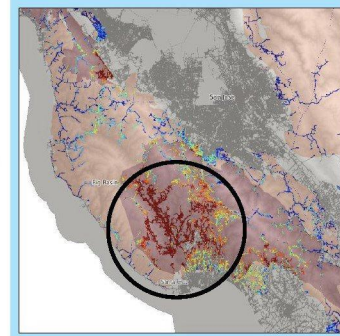

Places where there are similar conditions across the examined area are given a probability of the event occurring based on similarity to other ignition locations and a level of uncertainty

Identifying the right data

Covariate	Category	Source	Spatial resolution
100 hour fuels	Meteorological data	gridMET	~4km
1000 hour fuels	Meteorological data	gridMET	~4km
Burn index	Meteorological data	gridMET	~4km
Energy release	Meteorological data	gridMET	~4km
Precipitation average	Meteorological data	gridMET	~4km
Specific humidity	Meteorological data	gridMET	~4km
Vapor pressure deficit avg	Meteorological data	gridMET	~4km
Temperature max average	Meteorological data	gridMET	~4km
Wind avg	Meteorological data	RTMA	~2.5km
Wind max	Meteorological data	RTMA	~2.5km
Windy summer day pct	Meteorological data	RTMA	~2.5km
Gusty summer day pct	Meteorological data	RTMA	~2.5km
Tree height max	Tree data	Salo Sciences	100m
Tree height average	Tree data	Salo Sciences	100m
Impervious	Surface condition	NLCD	100m
Unburnable Location	Surface condition	LANDFIRE 2016	100m
Local topography	Surface condition	NED Database	100m
Age	Asset data	EDGIS Conductors	100m
Materials	Asset data	EDGIS Conductors	100m
Size	Asset data	EDGIS Conductors	100m
Splice count	Asset data	EDGIS Conductors	100m
Coastal indicator	Asset data	EDGIS Conductors	100m

Key Takeaways

- ❑ Potential drivers of ignition probability were identified and collected to improve the model efficacy
- ❑ Data sources with reliable and consistent information were identified for key factors for the analysis to maintain high input quality
- ❑ Temporal and Geospatial data was required to accurately investigate the various conditions that exist in PG&E operational region
- ❑ Where data was limited, such as portions of asset condition, proxies like age and material were used
- ❑ All data was validated and missing or incomplete datasets were assessed and mitigated

CONFIDENTIAL – FOR INTERNAL DISCUSSION

7

Right side overall impression about data Left side all the covariates

Pool A

Had outside vendors look at all of California to get data that could potentially impact fire behavior

How data was obtained

Consequence Approach

MODEL DETAIL

Methodology



- Understand how a fire spreads in varying weather conditions and environments along PG&E resources
- Results tied back to Ramp model with MAVF Scores
- Predict Fire spread along all HFTD assets with an ignition event

Approach



- Fire Spread simulations conducted at regular intervals along assets in HFTDs
- Utilize Technosylva Firesim – an industry standard for fire burn simulations taking into account environment and weather effects
- Consult with Fire Experts to review results

Ignition Probability



Spread: via 8 hour burn simulation (Technosylva Firesim)

Effect: via...

- Ignition Spread (Technosylva Firesim Acres Burned)
- Rate of Spread (Technosylva Firesim FBI)
- Burn Intensity (Technosylva Firesim FBI)
- Buildings Impacted (Technosylva Firesim Structures Impacted)

TECHNOSYLVA BURN SIMULATION


- Technosylva simulation of 8-hour burn every 200m along HFTD lines
- Simulations conducted with weather data from 452 worst historical fire weather days
- Outputs key consequence metrics: acres burned, population and structures impacted, and fire behavior index (FBI)
- FBI score based on flame length (burn intensity metric) and rate of spread (ROS)



FBI Class	Description
1 LOW	Fire will burn and will spread however it presents very little resistance to control and direct attack with firefighters is possible.
2 MODERATE	Fire spreads rapidly presenting moderate resistance to control but can be countered with direct attack by firefighters.
3 ACTIVE	Fire spreads very rapidly presenting substantial resistance to control. Direct attack with firefighters must be supplemented with equipment and/or air support.
4 VERY ACTIVE	Fire spreads very rapidly presenting extreme resistance to control. Indirect attack may be effective. Safety of firefighters in the area becomes a concern.
5 EXTREME	Fire spreads very rapidly presenting extreme resistance to control. Any form of attack will probably not be effective. Safety of firefighters in the area is of critical concern.

CONFIDENTIAL – FOR INTERNAL DISCUSSION

Creating a Risk Score

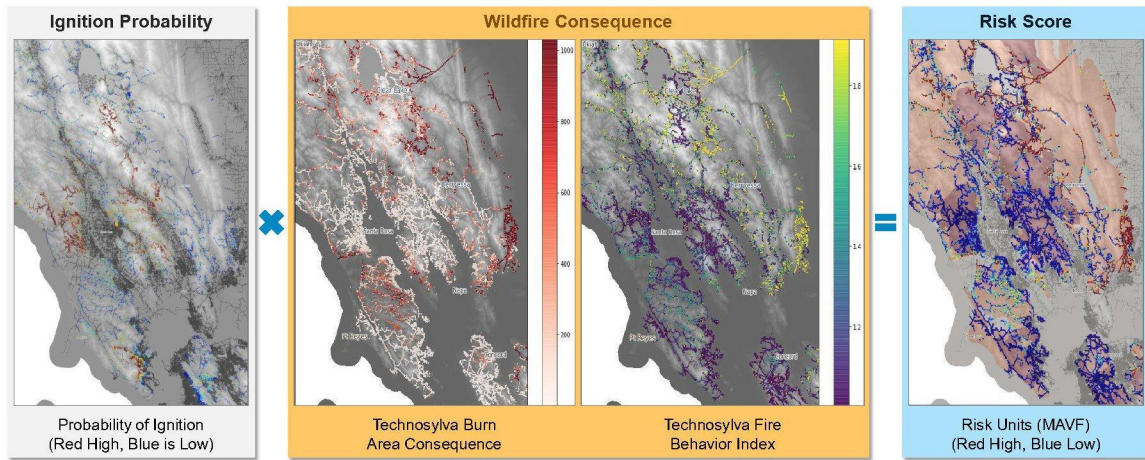


$$\text{Risk} = \text{Ignition Probability} \times \text{Wildfire Consequence}$$


CONFIDENTIAL - FOR INTERNAL DISCUSSION

9

Model Visualization and Application

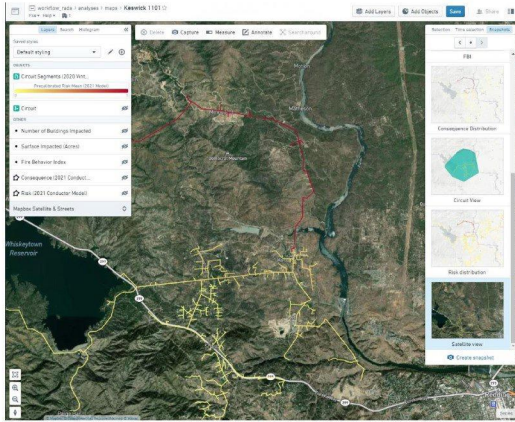

Circuit Segment View

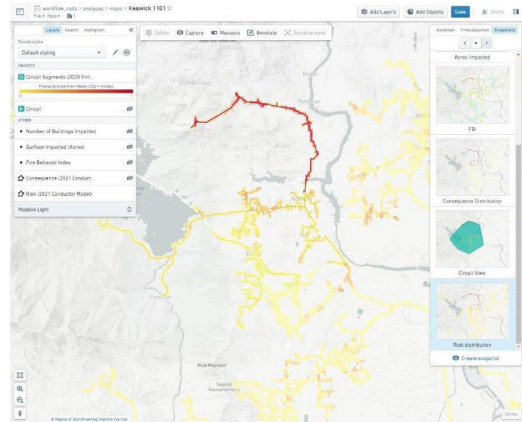

Risk Pixel View

Future Model Enhancements


- 2018**
- Senate Bill 901 outlines the process for filing the wildfire mitigation plan
 - Safety model assessment proceeding (SMAP) provides guidance on how risk should be assessed
 - SME opinion informs system hardening and mitigation decisions
 - Initial risk modeling approach developed

- 2019**
- Outage models are enhanced with random forest models to act as a proxy for ignitions
 - Consequence model is enhanced with information from Reax Engineering

- 2020**
- Enhanced Vegetation Model is enhanced with Maximum Entropy approach predicting ignitions
 - Conductor model is enhanced with Maximum Entropy approach predicting ignitions
 - Consequence is enhanced utilizing Technosylva to provide increased understanding of consequence

- 2021 +**
- Incorporate additional data sources such as Vegetation LIDAR, EC Tag information
 - Combined model for all ignition sources in development
 - Additional consequence metrics (egress, population) considered for inclusion
 - Additional granularity considered for model outputs


This timeline highlights key capabilities and model milestones over the next 12+ months to develop the 2022 models

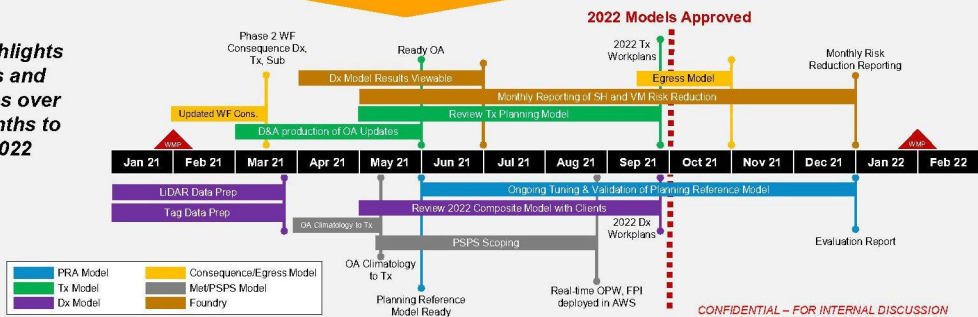

APPENDIX

CONFIDENTIAL -- FOR INTERNAL DISCUSSION

Evolution of Risk Assessment and Modeling

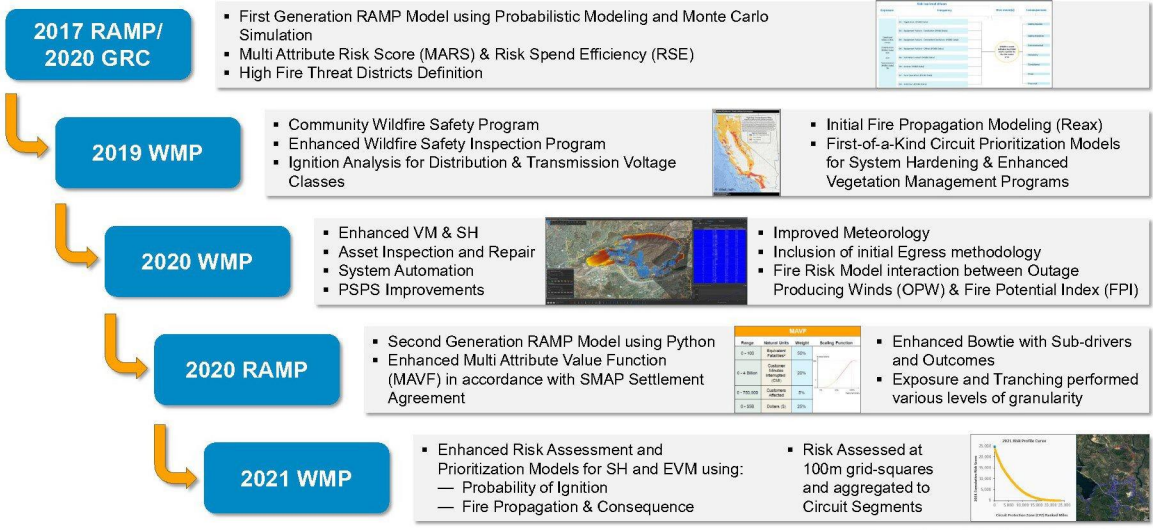

CONFIDENTIAL - FOR INTERNAL DISCUSSION

The information from the Technosylva fire simulations feeds the destructive fire probability calculations and ultimate risk score

Technosylva FireSim Results

Ignition Simulation #	Acres Burned	Buildings Destroyed	FBI Score	Destructive Fire Designation	
				True	False
1	400	45	3	1	0
2	600	23	2	1	0
3	550	75	1	0	1
.
.
.
452	300	40	1	0	1
Subtotal				85	340

Key Takeaways

- The Destructive Fire Probability takes into account multiple factors and outcomes from fire simulations and creates a singular usable score
- Probability scoring for destructive and catastrophic fires allow for the calibration of the outcomes to RAMP values for easier comparison to other risks

A fire simulation is considered destructive if:
 Acres Burned > 300 AND
 Buildings Impacted > 50 AND OR FBI > 3
 FBI > 2

Destructive Probability 20%