
From: [REDACTED]
To: [REDACTED]
Sent: 7/14/2021 9:47:52 AM
Subject: RE: Update: "Dixie" Fire

Copy.

From: [REDACTED]
Sent: Wednesday, July 14, 2021 9:44 AM
To: [REDACTED]
Subject: RE: Update: "Dixie" Fire

Hold on drafting for now....

From: [REDACTED]
Sent: Wednesday, July 14, 2021 9:43 AM
To: [REDACTED]
Subject: RE: Update: "Dixie" Fire

Just spoke to the PSS. Here are the key info I asked for as I knew we'd all be wondering. Will draft some TPs now for reviews.

Wind direction: In the Feather River Canyon, winds go up canyon starting at about 10 a.m. in summer (east, northeast) and down canyon starting at about 10 p.m. as the higher elevations cool. This is typical summer conditions we are experiencing. During the Camp Fire, we had a strong, dry northwind that pushed the fire to Concow and Paradise. Not the case here. Canyon area is sparsely populated and this is mainly USFS land, but here Cal Fire provides protection.

We do not expect to de-energize the 230-kv Caribou-Table Mt. line, but just getting ready in case.

Three customers impacted are the highway tunnel lights by [REDACTED] and PG&E.

From: [REDACTED]
Sent: Wednesday, July 14, 2021 9:23 AM
To: [REDACTED]
Subject: FW: Update: "Dixie" Fire

From: [REDACTED]
Sent: Wednesday, July 14, 2021 9:20 AM
To: [REDACTED]
Subject: Update: "Dixie" Fire

Update:

T-line personnel report that the "Dixie" fire is burning between Caribou-Table Mountain 230kV line at tower 27/196 and Rock Creek-Poe 230kV line at tower 1/18. The Bucks Creek-Rock Creek-Poe 230kV line is in the right of way corridor as well. The fire is burning towards and within 200 yards of the Caribou-Table Mountain 230kV line. The

fire is moving at a low rate of spread and mostly made up of grass low and is zero percent contained with no current threat to PG&E assets.


GCC is preparing switching to de-energize and clear the Caribou-Table Mountain 230kV line if needed which will include operating the Caribou 115/60kV system in a controlled island condition. Field personnel are in place to perform set up switching and load transfers as needed.

[REDACTED]
Senior Transmission System Dispatcher
Vacaville Grid Control Center



From: [REDACTED]
Sent: Tuesday, July 13, 2021 7:08 PM
To: [REDACTED]
Cc: [REDACTED]
Subject: "Dixie" Fire

2 acre fire near Rock Creek-Poe 230kV line. Winds blowing south towards the lines. Firefighting personnel on site fighting the fire. Personnel have been dispatched.

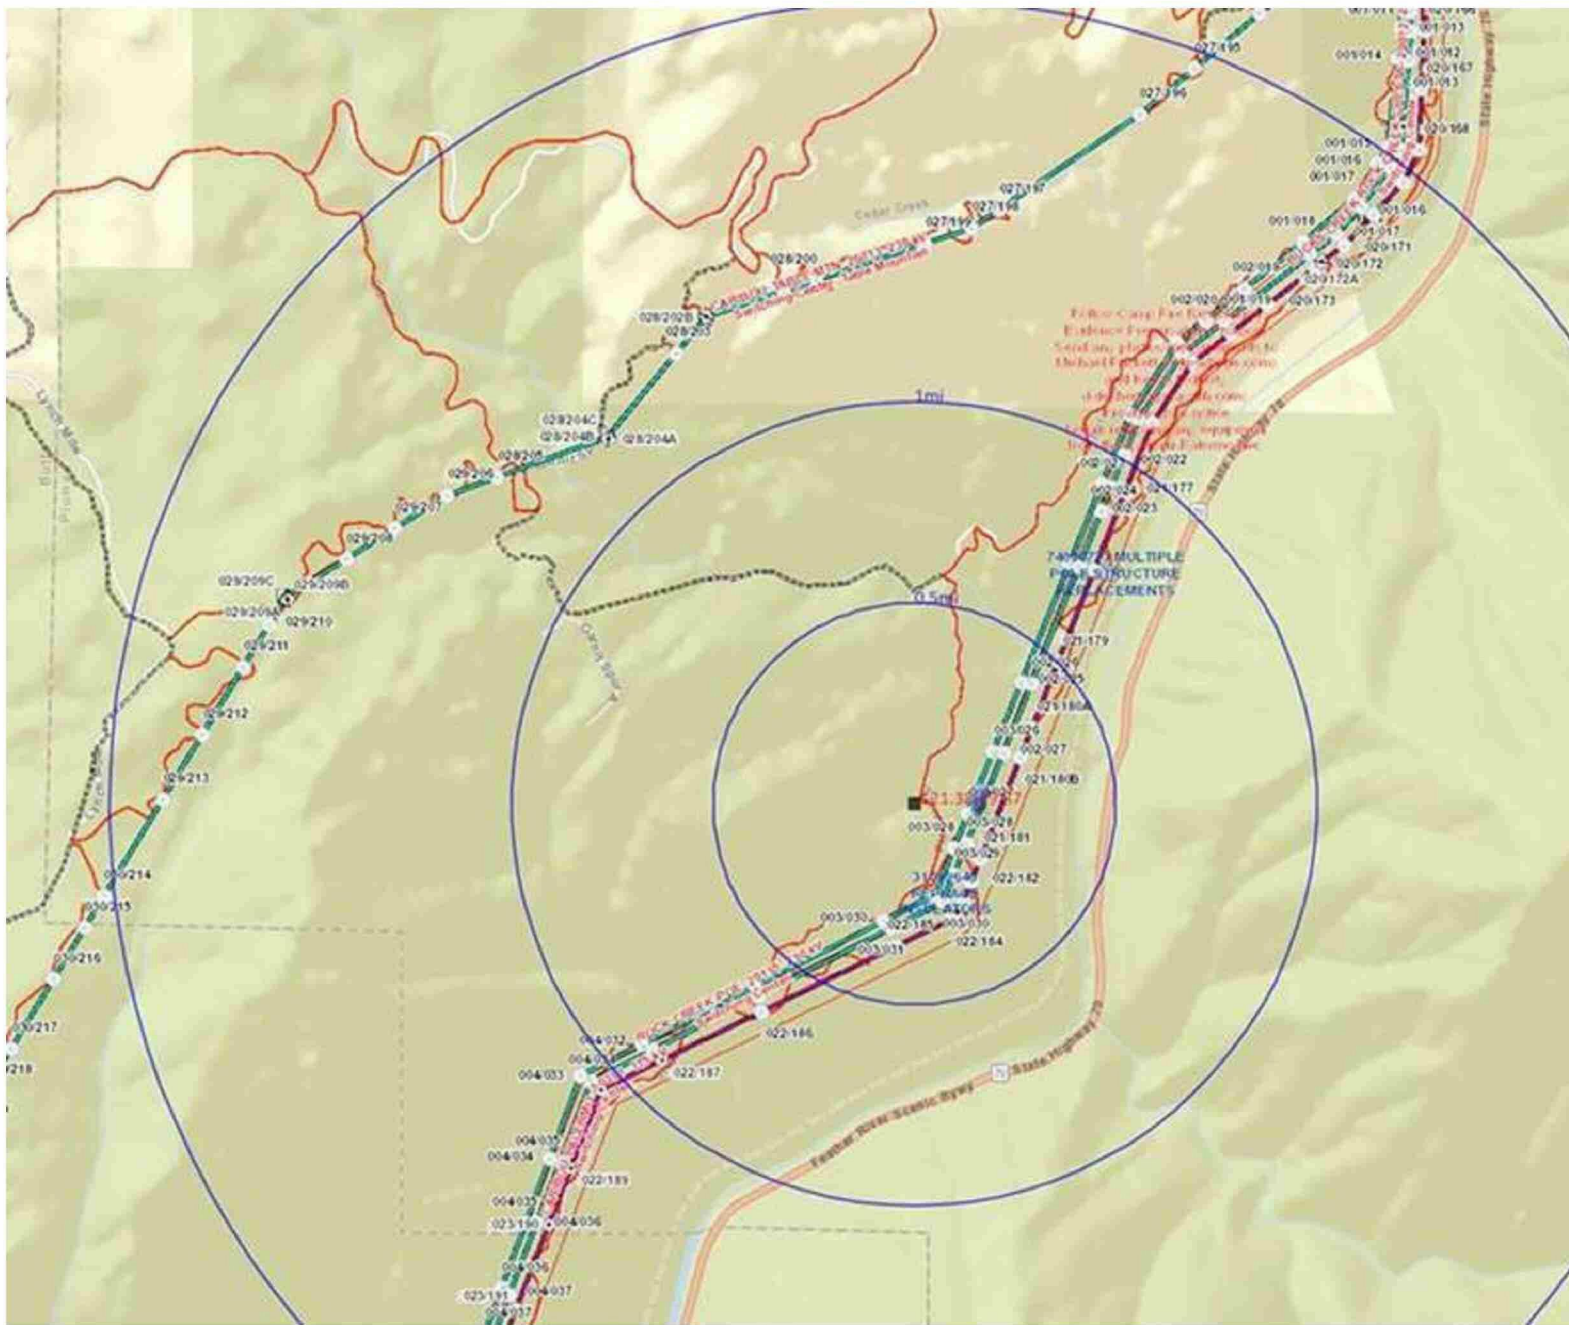

[REDACTED]
Operations Supervisor | Pacific Gas & Electric
[REDACTED]