

From: [REDACTED]
To: [REDACTED]
CC: [REDACTED]
Sent: 7/13/2021 10:17:30 AM
Subject: RE: Urgent Request could you please provide a response by EOB 7/14/21

Thank you!!

From: [REDACTED]
Sent: Tuesday, July 13, 2021 10:16 AM
To: [REDACTED]
Cc: [REDACTED]
Subject: RE: Urgent Request could you please provide a response by EOB 7/14/21


Hi [REDACTED] –

Thank you for the clarification. The new 230/115kV transformer at Bucks Creek PH Is needed due to the decommissioning of the Caribou - Palermo 115kV following the Camp Fire. The new transformer will allow Grizzly PH to generate and feed into the 230kV line.

Please let me know if you have any additional questions.

Thanks,

[REDACTED]

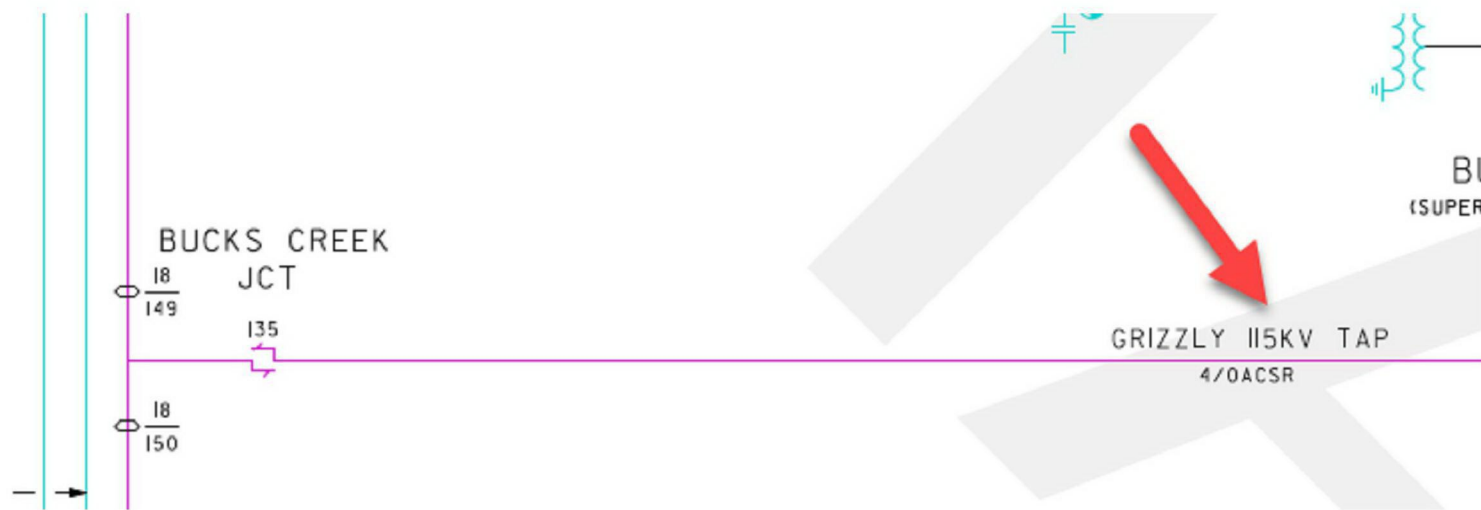

From: [REDACTED]
Sent: Tuesday, July 13, 2021 10:01 AM
To: [REDACTED]
Cc: [REDACTED]
Subject: RE: Urgent Request could you please provide a response by EOB 7/14/21

[REDACTED]

I think they are asking why do we need the new 230/115kV transformer at Bucks Creek PH?

Thanks so much,
[REDACTED]

From: [REDACTED]
Sent: Tuesday, July 13, 2021 9:40 AM
To: [REDACTED]
Cc: [REDACTED]
Subject: RE: Urgent Request could you please provide a response by EOB 7/14/21

Hi [REDACTED] –

Are you inquiring about Bank 11 at Caribou? Or another portion of the attachment?

Thanks,
[REDACTED]

From: [REDACTED]
Sent: Tuesday, July 13, 2021 9:09 AM
To: [REDACTED]
Cc: [REDACTED]
Subject: FW: Urgent Request could you please provide a response by EOB 7/14/21
Importance: High

Hi [REDACTED]

Would you know from the Bucks Creek PH Reconnection Sub NU Work:

The last condition report for the 230/115 kV transformer proposed for replacement that indicates a need for this replacement?

Thanks again,
[REDACTED]

From: Travis, Christopher [REDACTED]
Sent: Monday, July 12, 2021 3:01 PM
To: [REDACTED]
Cc: [REDACTED]
Subject: FW: Urgent Request could you please provide a response by EOB 7/14/21
Importance: High

Classification: [Internal](#)

The present 230/115kv Transformer bank that used to feed the 115kv line that tied in with Silicon Valley Power out of Grizzly PH is still in service. I do believe this to be Caribou Bank#11 which currently feeds the Caribou/Butt Valley 115kv line, along with the 60kv at Caribou PH#1 as well. So I believe this to be a 230/115/60kv bank if I have referenced the single line correctly. Sorry for the separate emails on this, just wanting to cover everything I can for the most accurate assessment. You also may want to reach out to [REDACTED] in regards to this as well.

Regards,
[REDACTED]
[REDACTED]

Substation Construction Table Mtn. Area 6
Working Foreman B

From: [REDACTED]
Sent: Monday, July 12, 2021 2:14 PM
To: [REDACTED]
Subject: FW: Urgent Request could you please provide a response by EOB 7/14/21
Importance: High

From: [REDACTED]
Sent: Monday, July 12, 2021 2:14:04 PM (UTC-08:00) Pacific Time (US & Canada)
To: [REDACTED]
Cc: [REDACTED]
Subject: FW: Urgent Request could you please provide a response by EOB 7/14/21

[REDACTED]

Is there anyway you could please answer 1 question for [REDACTED] or provide any information in the attachment?

[REDACTED]

Would you be able to answer 1 question in the attachment also?

We would like this by 7/14 EOB if that is possible?

Thank you so much,
[REDACTED]

From: [REDACTED]
Sent: Monday, July 12, 2021 1:54 PM
To: [REDACTED]
Subject: FW: Urgent Request could you please provide a response by EOB 7/14/21
Importance: High

FYI

From: [REDACTED]
Sent: Friday, July 9, 2021 11:42 AM
To: [REDACTED]
Cc: [REDACTED]
Subject: Urgent Request could you please provide a response by EOB 7/14/21
Importance: High

Hi Team,

This is an urgent request could you please provide a response by EOB 7/14/21.

Thank you so much!

