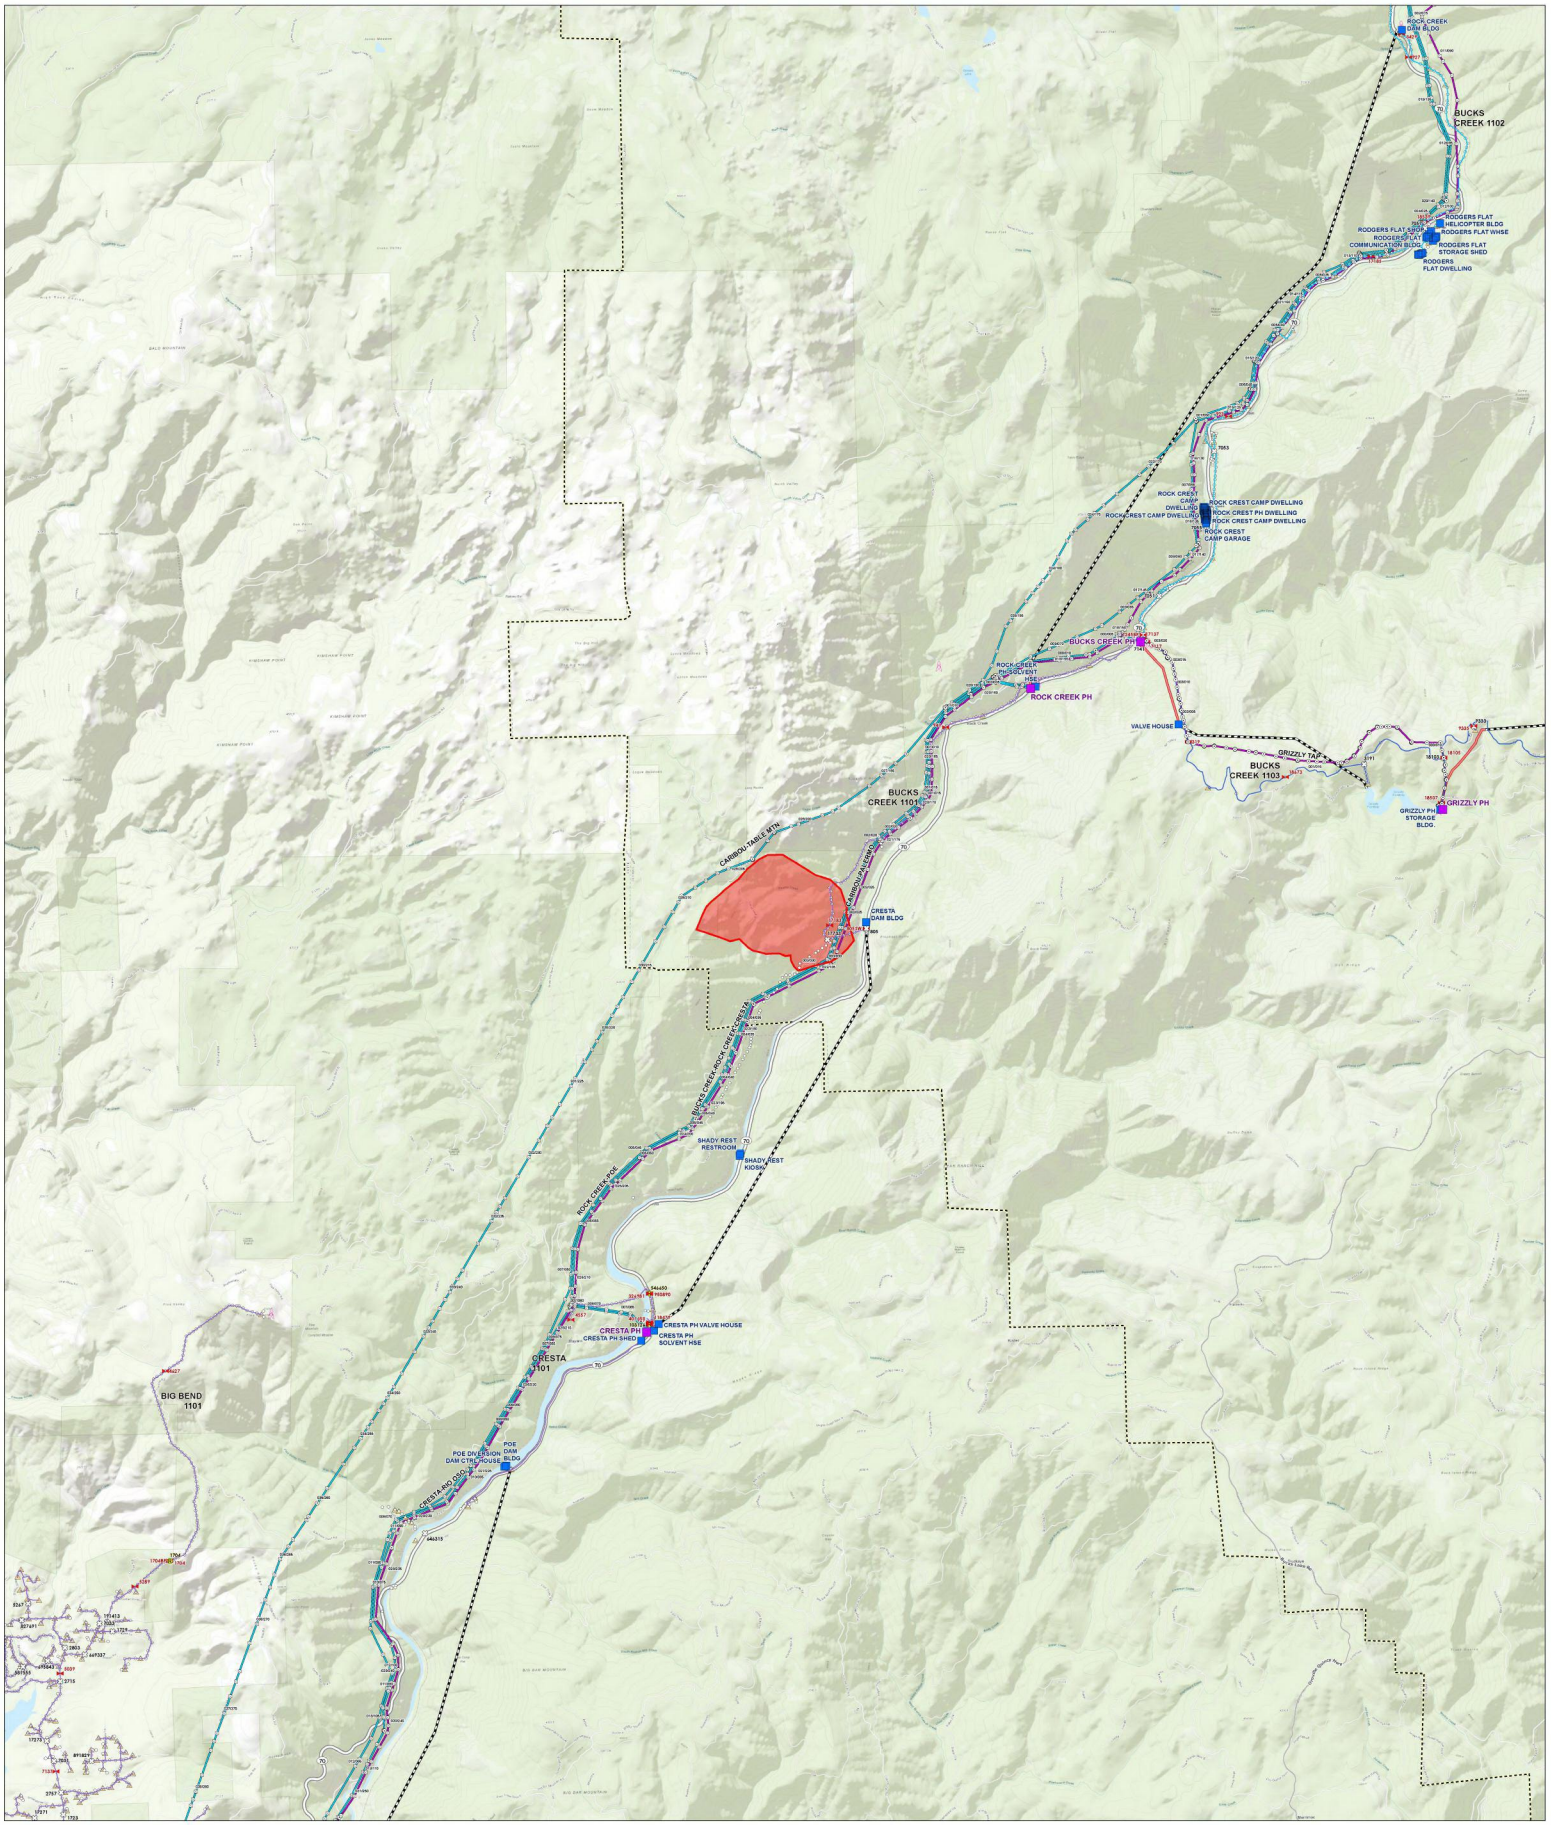

Dixie Fire Overview

Wednesday, July 14, 2021 11:39:55 AM

PG&E Critical Infrastructure Information Exempt From Public Disclosure Must Be Held In Confidence Facilites to be Operated by PG&E Personnel Only

Pacific Gas and Electric Company

PG&E Division

PG&E Assets
- Power house
- Hydro bldg
- Pole
- Tower
- Fuse (Operating No. Label in Black)
- Recloser (Operating No. Label in Black)
- Switch (Operating No. Label in Red)
- Telecom Site
- Distribution Poles
- Distribution Transformer

Electric Transmission
RATED KV
- 115 kV
- 230 kV
- Penstock
- Conveyance
- Tunnels

Incident Data
- Dixie IR Perimeter, 7/14 05:00

Electric Distribution Feeder: Random Color for Display

1:24,000
0 0.6 1.2 1.8 Miles



PGE-DIXIE-NDCAL-000020616